


3M INTERAM E-5A-4 GROUNDING
TYPICAL FOR CV02, CV07, CV08, T-9, CV09, CV10 AND CV11

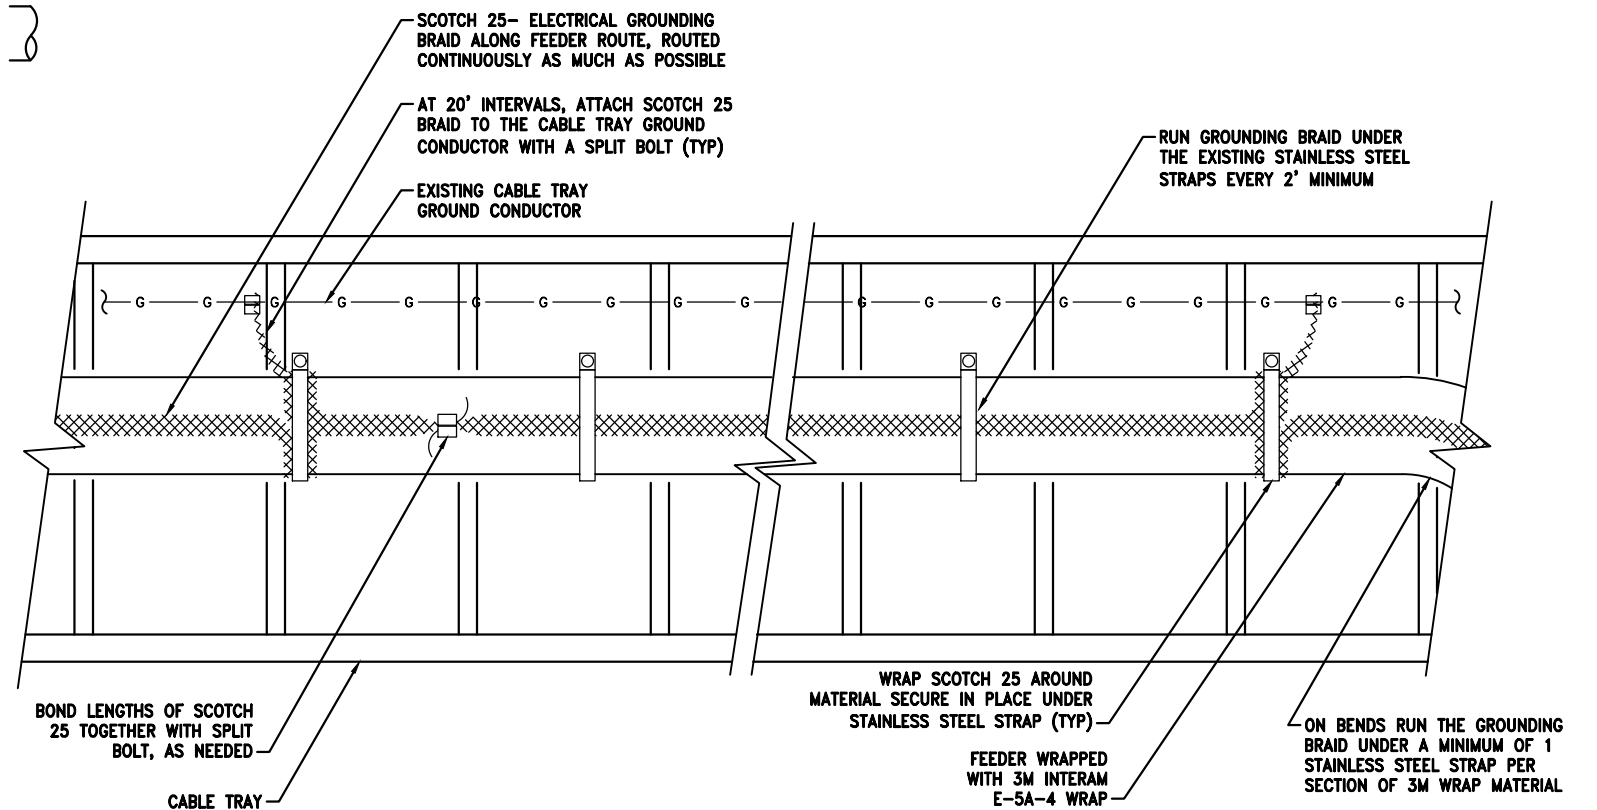

3M INTERAM E-5A-4 GROUNDING FOR CV01 (CABLE TRAY)

REVISIONS

NO.	DATE	BY	DESCRIPTION
1	03/01/2019	KDM	2019 F&I STANDARD DETAILS
2	03/01/2020	KDM	2020 F&I STANDARD DETAILS

PROJECT MANAGER:
—

PROJECT ENGINEER:
—

DESIGN ENGINEER:
—

DRAFTER:
—

SCALE:
AS NOTED

DATE:
—

CHECKED/APPROVED BY:
—



SEA-TAC INTERNATIONAL AIRPORT

PROJECT: **F&I STANDARD DETAILS**

SHEET TITLE: **CABLE VAULT GROUNDING DETAILS**
CABLE SUPPORT AND MANHOLE DETAILS

WORK PROJECT NO.

CONSULTANT'S NO.

PORT OF SEATTLE NO.

260526

06